


SECTION X-X

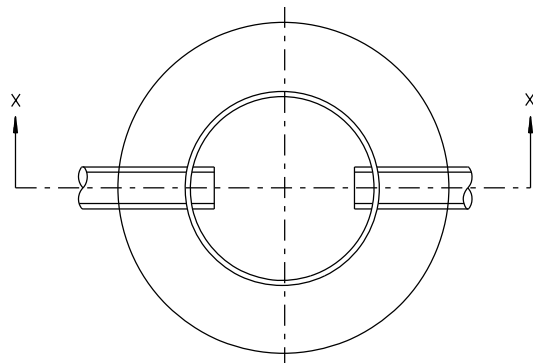


STANDARD SIDE ENTRY

NOTES.

1. AVOID DISTORTION DURING COMPACTION SUCH THAT THE MINIMUM DIAMETRIC DIMENSION EXCEEDS 580.
2. ENDS OF CONDUITS TO BE TRIMMED NEATLY AND FREE FROM SHARP EDGES OR BURRS.
3. ADEQUATE DRAINAGE TO AN APPROVED OUTLET SHALL BE PROVIDED.
4. BASE ENTRY TO BE USED ONLY WHERE DEEP CONDUIT RUNS ARE REQUIRED.

MATERIALS REQUIRED PER PIT.

- CABLE PIT FORMER
- ACCESS COVER AND FRAME, WITH COVER SUITABLY INSCRIBED AS PER SPECIFICATION.
- HEAVY DUTY ORANGE OR WHITE CONDUIT AS REQUIRED.
- REINFORCEMENT RINGS, 750 dia. AND 900 dia. WIRE WITH EIGHT LIGATURE.
- CONDUIT JOINTING CEMENT, CRUSHED ROCK, CONCRETE, MORTAR ETC. AS REQUIRED.

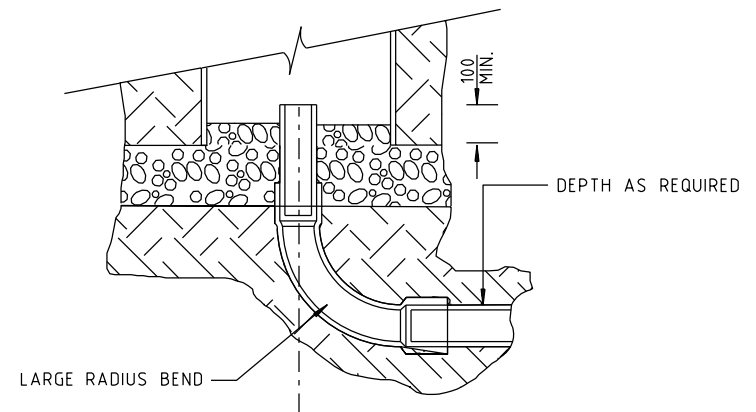

BASE ENTRY

THIS DRAWING SUPERSEDES No. 854042 (IN PART)

E				
D				
C				
B	S.P.	13/2/13	NOTES AMENDED TITLE BLOCK UPDATED	
A	J.R.	22/8/96	NOTES AMENDED AND EARTH STAKE DELETED	
AMEND.	APP'D	DATE	AMENDMENT	

GENERAL NOTES/CROSS REFERENCES
UNSPECIFIED DIMENSIONS ARE IN mm
TC-1210 CABLE PIT FORMER
TC-1220 CABLE PIT ACCESS COVER & FRAME

INTELLIGENT
TRANSPORT
SYSTEMS
60 DENMARK STREET
KEW,
VICTORIA, 3101
PHONE (03) 9854 2111
FAX (03) 9854 2319

CHECKED
J. RANDALL 21/12/95
APPROVED
B. HEARN 21/12/95 T.S.O. MANAGER
CAT:
PROJ:
FILE:



SCALE OF METRES
HOR. NOT TO SCALE
VER.

FILE NO.	SPEC. REF.	SHEET NO.	DRAWING NO. TC-1230	AMEND. B
----------	------------	-----------	------------------------	-------------

STANDARD DRAWING
CABLE PIT
INSTALLATION DETAILS